

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Overview



Our field devices for heavy industrial use

- HART, Universal
- 4 to 20 mA, universal
- Field indicator for 4 to 20 mA signals

The temperature transmitter SITRANS TF works where others feel uncomfortable.

Benefits

- Universal use
 - as transmitter for resistance thermometer, thermocouple element, Ω or mV signal
 - as field indicator for any 4 to 20 mA signals
- Local sensing of measured values over digital display
- Rugged two-chamber enclosure in die-cast aluminium or stainless steel
- Degree of protection IP66/67/68
- Test terminals for direct read-out of the output signal without breaking the current loop
- Can be mounted elsewhere if the measuring point
 - is hard to access,
 - is subject to high temperatures,
 - is subject to vibrations from the system,
 - or if you want to avoid long neck tubes and/or protective tubes.
- Can be mounted directly on American-design sensors
- Wide range of approvals for use in potentially explosive atmospheres. "Intrinsically safe, non-sparking and flameproof" type of protections, for Europe and USA.
- SIL2 (with Order code C20), SIL2/3 (with C23)

Application

SITRANS TF can be used everywhere where temperatures need to be measured under particularly adverse conditions, or where a convenient local display is ideal. Which is why users from all industries have opted for this field device. The rugged enclosure protects the electronics. The stainless steel model is almost completely resistant to sea water and other aggressive elements. The inner workings offer high measuring accuracy, universal input and a wide range of diagnostic options.

Function

Configuration

The communication capability over the HART protocol V 5.9 of the SITRANS TF with an integrated SITRANS TH300 permits parameterization using a PC or HART communicator (hand-held communicator). The SIMATIC PDM makes it easy.

Parameterization is carried out using a PC for SITRANS TF with the integrated and programmable SITRANS TK. Available for this purpose are a special modem and the software tool SIPROM T.

Mode of operation

Mode of operation of SITRANS TF as temperature transmitter

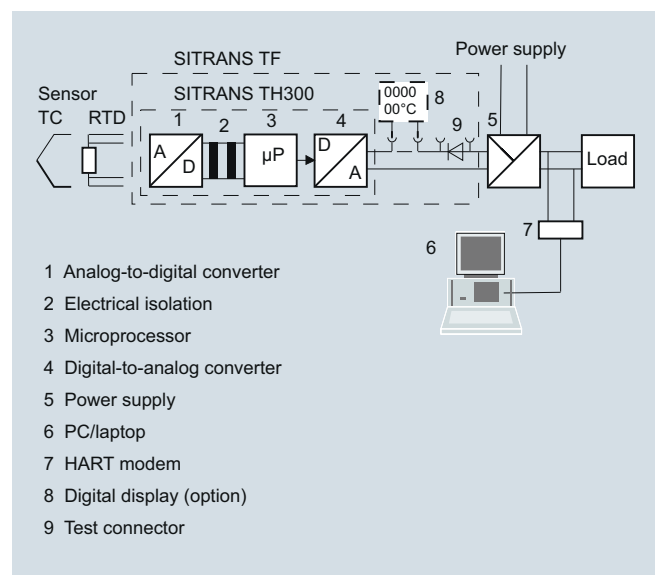
The sensor signal, whether resistance thermometer, thermocouple element or Ω or mV signal, is amplified and linearized. Sensor and output side are electrically isolated. An internal cold junction is integrated for measurements with thermocouple elements.

The device outputs a temperature-linear direct current of 4 to 20 mA. As well as the analog transmission of measured values from 4 to 20 mA, the HART version also supports digital communication for online diagnostics, measured value transmission and configuration.

SITRANS TF automatically detects when a sensor should be interrupted or is indicating a short-circuit. The practical test terminals allow direct measurement of 4 to 20 mA signals over an ammeter without interrupting the output current loop.

Mode of operation of SITRANS TF as field indicator

Any 4 to 20 mA signal can be applied to the generous terminal block. As well as a range of predefined measurement units, the adjustable indicator also supports the input of customized units. This means that any 4 to 20 mA signal can be represented as any type of unit, e.g. pressure, flow rate, filling level or temperature.



Mode of operation: SITRANS TF with integrated transmitter and digital display

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Technical specifications

Input

Resistance thermometer

Measured variable	Temperature
Sensor type	
• to IEC 60751	Pt25 ... Pt1000
• to JIS C 1604; $\alpha=0.00392$ K-1	Pt25 ... Pt1000
• to IEC 60751	Ni25 ... Ni1000
Units	°C and °F
Connection	
• Normal connection	1 resistance thermometer (RTD) in 2-wire, 3-wire or 4-wire system
• Generation of average value	Series or parallel connection of several resistance thermometers in a two-wire system for the generation of average temperatures or for adaptation to other device types
• Generation of difference	2 resistance thermometers (RTD) in 2-wire system (RTD 1 – RTD 2 or RTD 2 – RTD 1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	≤ 0.45 mA
Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Always active (cannot be disabled)
Short-circuit monitoring	can be switched on/off (default value: ON)
Measuring range	parameterizable (see table "Digital measuring errors")
Min. measured span	10 °C (18 °F)
Characteristic curve	Temperature-linear or special characteristic

Resistance-based sensors

Measured variable	Actual resistance
Sensor type	Resistance-based, potentiometers
Units	Ω
Connection	
• Normal connection	1 resistance-based sensor (R) in 2-wire, 3-wire or 4-wire system
• Generation of average value	2 resistance-based sensors in 2-wire system for generation of average value
• Generation of difference	2 resistance-based sensor in 2-wire system (R 1 – R 2 or R 2 – R 1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	≤ 0.45 mA
Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Can be switched off
Short-circuit monitoring	Can be switched off (value is adjustable)

Measuring range

Min. measured span

Characteristic curve

Thermocouples

Measured variable

Sensor type (thermocouples)

- Type B
- Type C
- Type D
- Type E
- Type J
- Type K
- Type L
- Type N
- Type R
- Type S
- Type T
- Type U

Units

Connection

- Normal connection
- Generation of average value
- Generation of difference

Response time

Open-circuit monitoring

Cold junction compensation

- Internal
- External
- External fixed

Measuring range

Min. measured span

Characteristic curve

mV sensor

Measured variable

Sensor type

Units

Response time

Open-circuit monitoring

Measuring range

Min. measured span

Overload capability of the input

Input resistance

Characteristic curve

parameterizable max. 0 ... 2200 Ω (see table "Digital measuring errors")

5 ... 25 Ω (see Table "Digital measuring errors")

Resistance-linear or special characteristic

Temperature

Pt30Rh-Pt6Rh to DIN IEC 584
W5 %-Re acc. to ASTM 988
W3 %-Re acc. to ASTM 988
NiCr-CuNi to DIN IEC 584
Fe-CuNi to DIN IEC 584
NiCr-Ni to DIN IEC 584
Fe-CuNi to DIN 43710
NiCrSi-NiSi to DIN IEC 584
Pt13Rh-Pt to DIN IEC 584
Pt10Rh-Pt to DIN IEC 584
Cu-CuNi to DIN IEC 584
Cu-CuNi to DIN 43710

°C or °F

1 thermocouple (TC)

2 thermocouples (TC)

2 thermocouples (TC)
(TC 1 – TC 2 or TC 2 – TC 1)

≤ 250 ms for 1 sensor with open-circuit monitoring

Can be switched off

With integrated Pt100 resistance thermometer

With external Pt100 IEC 60751 (2-wire or 3-wire connection)

Cold junction temperature can be set as fixed value

parameterizable (see table "Digital measuring errors")

Min. 40 ... 100 °C (72 ... 180 °F) (see table "Digital measuring errors")

Temperature-linear or special characteristic

DC voltage

DC voltage source (DC voltage source possible over an externally connected resistor)

mV

≤ 250 ms for 1 sensor with open-circuit monitoring

Can be switched off

-10 ... +70 mV
-100 ... +1100 mV

2 mV or 20 mV

-1.5 ... +3.5 V DC

$\geq 1 \text{ M}\Omega$

Voltage-linear or special characteristic

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Output Output signal Communication with SITRANS TH300		Auxiliary power Without digital display With digital display Electrically isolated • Test voltage	
Digital display Digital display (optional) Display Digit height Display range Units Setting: Zero point, full-scale value and unit Load voltage		4 ... 20 mA, 2-wire acc. to HART Rev. 5.9 In current loop Max. 5 digits 9 mm (0.35 inch) -99 999 ... + 99 999 any (max. 5 char.) with 3 buttons 2.1 V	
Measuring accuracy Digital measuring errors Reference conditions • Auxiliary power • Load • Ambient temperature • Warming-up time Error in the analog output (digital/analog converter) Error due to internal cold junction Influence of ambient temperature • Analog measuring error • Digital measuring errors - with resistance thermometers - with thermocouples Auxiliary power effect Effect of load impedance Long-term drift • In the first month • After one year • After 5 years		See table "Digital measuring errors" 24 V ± 1 % 500 Ω 23 °C (73.4 °F) > 5 min < 0.025 % of span < 0.5 °C (0.9 °F) 0.02 % of span/10 °C (18 °F) 0.06 °C (0.11 °F)/10°C (18 °F) 0.6 °C (1.1 °F)/10°C (18 °F) < 0.001 % of span/V < 0.002 % of span/100 Ω < 0.02 % of span < 0.3 % of span < 0.4 % of span	
Conditions of use <u>Ambient conditions</u> Storage temperature Condensation Electromagnetic compatibility Degree of protection to EN 60529		- EC type test certificate • "Operating equipment that is non-ignitable and has limited energy for zone 2" type of protection - EC type test certificate • "Flame-proof enclosure" type of protection - EC type test certificate Explosion protection to FM • Identification (XP, DIP, NI, S)	
Construction Weight Dimensions Enclosure material Electrical connection, sensor connection Mounting bracket (optional)		-40 ... +85 °C (-40 ... +185 °F) Permissible According to EN 61326 and NAMUR NE21 IP66/67/68 Approx. 1.5 kg (3.3 lb) without options See "Dimensional drawings" Die-cast aluminum, low in copper, GD-AlSi 12 or stainless steel, polyester-based lacquer, stainless steel rating plate Screw terminals, cable inlet via M20 x 1.5 or ½-14 NPT screwed gland Steel, galvanized and chrome-plated or stainless steel	
		Hardware and software requirements • For the parameterization software SIPROM T for SITRANS TF with TH200 - Personal computer - PC operating system • For the parameterization software SIMATIC PDM for SITRANS TH300	
		Communication Load for HART connection • Two-core shielded • Multi-core shielded Protocol	
		11 ... 35 V DC (30 V for Ex ib; 32 V for Ex ic and Ex nA) 13.1 ... 5 V DC (30 V for Ex ib; 32 V for Ex ic and Ex nA) Between input and output $U_{eff} = 1 \text{ kV}, 50 \text{ Hz}, 1 \text{ min}$ with digital display: II 2 (1) G Ex ib [ia Ga] IIC T4 Gb II 2 G Ex ib IIC T4 Gb II 1D Ex ia IIIC T100 °C Da without digital display: II 2 (1) G Ex ib [ia Ga] IIC T6 Gb II 2 G Ex ib IIC T6 Gb II 1D Ex ia IIIC T100 °C Da ZELM 11 ATEX 0471 X II 3 G Ex ic IIC T6/T4 Gc II 3 G Ex nA IIC T6/T4 Gc II 3 G Ex nA [ic] IIC T6/T4 Gc ZELM 11 ATEX 0471 X II 2 G Ex d IIC T6/T5 Gb II 2 D Ex tb IIIC T100 °C Db ZELM 11 ATEX 0472 X Certificate of Compliance 3017742 • XP/II/1/BCD/T5 Ta = 85 °C (185 °F), T6 Ta = 60 °C (140 °F), Type 4X • DIP/II, III/1/EFG/T5 Ta = 85 °C (185 °F), T6 Ta = 60 °C (140 °F), Type 4X • NI/II/2/ABCD/T5 Ta = 85 °C (185 °F), T6 Ta = 60 °C (140 °F), Type 4X • S/II, III/2/FG/T5 Ta = 85 °C (185 °F), T6 Ta = 60 °C (140 °F), Type 4X Other certificates IECEx, EAC Ex(GOST), INMETRO, NEPSI, KOSHA	
		PC with CD-ROM drive and USB Windows 98, NT, 2000, XP, 7 and Win 8 See chapter 8 "Software", "SIMATIC PDM"	
		230 ... 1100 Ω ≤ 3.0 km (1.86 mi) ≤ 1.5 km (0.93 mi) HART protocol, version 5.9	
		Factory setting (transmitter): • Pt100 (IEC 751) with 3-wire circuit • Measuring range: 0 ... 100 °C (32 ... 212 °F) • Error signal in the event of sensor breakage: 22.8 mA • Sensor offset: 0 °C (0 °F) • Damping 0.0 s	

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Digital measuring errors

Resistance thermometer

Input	Measuring range	Min. mea- sured span		Digital accuracy	
	°C / (°F)	°C	(°F)	°C	(°F)
to IEC 60751					
Pt25	-200 ... +850 (-328 ... +1562)	10	(18)	0.3	(0.54)
Pt50	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +850 (-328 ... +1562)	10	(18)	0.1	(0.18)
Pt500	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
to JIS C1604-81					
Pt25	-200 ... +649 (-328 ... +1200)	10	(18)	0.3	(0.54)
Pt50	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +649 (-328 ... +1200)	10	(18)	0.1	(0.18)
Pt500	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
Ni 25 ... Ni1000	-60 ... +250 (-76 ... +482)	10	(18)	0.1	(0.18)

Resistance-based sensors

Input	Measuring range	Min. mea- sured span		Digital accuracy	
	Ω	Ω		Ω	
Resistance	0 ... 390	5		0.05	
Resistance	0 ... 2200	25		0.25	

Thermocouples

Input	Measuring range	Min. mea- sured span		Digital accuracy	
	°C / (°F)	°C	(°F)	°C	(°F)
Type B	100 ... 1820 (212 ... 3308)	100	(180)	2 ¹⁾	(3.6) ¹⁾
Type C (W5)	0 ... 2300 (32 ... 4172)	100	(180)	2	(3.6)
Type D (W3)	0 ... 2300 (32 ... 4172)	100	(180)	1 ²⁾	(1.8) ²⁾
Type E	-200 ... +1000 (-328 ... +1832)	50	(90)	1	(1.8)
Type J	-210 ... +1200 (-346 ... +2192)	50	(90)	1	(1.8)
Type K	-200 ... +1370 (-328 ... +2498)	50	(90)	1	(1.8)
Type L	-200 ... +900 (-328 ... +1652)	50	(90)	1	(1.8)
Type N	-200 ... +1300 (-328 ... +2372)	50	(90)	1	(1.8)
Type R	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.6)
Type S	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.6)
Type T	-20 ... +400 (-328 ... +752)	40	(72)	1	(1.8)
Type U	-200 ... +600 (-328 ... +1112)	50	(90)	2	(3.6)

¹⁾ The digital accuracy in the range 100 to 300 °C (212 to 572 °F) is 3 °C (5.4 °F).

²⁾ The digital accuracy in the range 1750 to 2300 °C (3182 to 4172 °F) is 2 °C (3.6 °F).

mV sensor

Input	Measuring span	Min. mea- sured span		Digital accuracy	
	mV	mV		μV	
mV sensor	-10 ... +70	2		40	
mV sensor	-100 ... +1100	20		400	

The digital accuracy is the accuracy after the analog/digital conversion including linearization and calculation of the measured value.

An additional error is generated in the output current 4 to 20 mA as a result of the digital/analog conversion of 0.025 % of the set span (digital-analog error).

The total error under reference conditions at the analog output is the sum from the digital error and the digital-analog error (poss. with the addition of cold junction errors in the case of thermocouple measurements).

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Selection and Ordering data	Article No.	Further designs	Order code
Temperature transmitter in field housing Two-wire system 4 ... 20 mA, with electrical isolation, with documentation on MiniDVD Click on the Article No. for the online configuration in the PIA Life Cycle Portal.	7NG313	Please add "-Z" to Article No. and specify Order code(s) and plain text. Test protocol (5 measuring points) Functional safety SIL2 Functional safety SIL2/3 Explosion protection • Explosion protection Ex ia to INMETRO (Brazil) (only with 7NG313.-1....) • Explosion protection Ex d to INMETRO (Brazil) (only with 7NG313.-4....) • Explosion protection Ex nA to INMETRO (Brazil) (only with 7NG313.-2....) • Explosion protection Ex i to NEPSI (China) (only with 7NG313.-1....) • Explosion protection Ex d to NEPSI (China) (only with 7NG313.-4....) • Explosion protection Ex nA to NEPSI (China) (only with 7NG313.-2....) • Explosion protection Ex d to KOSHA (Korea) (only with 7NG313.-4....) • Explosion protection Ex i according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-1....) • Explosion protection Ex d according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-4....) • Explosion protection Ex nA according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-2....) Marine approvals • Det Norske Veritas Germanischer Lloyd (DNV GL) • Bureau Veritas (BV) • Lloyd's Register of Shipping (LR) • American Bureau of Shipping (ABS) Two coats of lacquer on casing and cover (PU on epoxy) Transient protection Cable gland CAPRI 1/2 NPT ADE 4F, nickel-plated brass (CAPRI 848694 and 810634) included Cable gland 1/2 NPT ADE 1F, cable diam. 6 ... 12 (CAPRI 818694 and 810534) included Cable gland 1/2 NPT ADE 4F, stainless steel (CAPRI 848699 and 810634) included Cable gland 1/2 NPT ADE 1F, cable diam. 4 ... 8.5 (CAPRI 818674 and 810534) included	C11 C20 C23 E25 E26 E27 E55 E56 E57 E70 E81 E82 E83 D01 D02 D04 D05 G10 J01 D57 D58 D59 D60
Integrated transmitter SITRANS TH200, programmable • Without Ex protection • With Ex ia • With Ex nAL for zone 2 • Total device SITRANS TF Ex d ¹⁾ • Total device SITRANS TF according to FM (XP, DIP, NI, S) ¹⁾ SITRANS TH300, communication capability according to HART V 5.9 • Without Ex-protection • With Ex ia • With Ex nAL for zone 2 • Total device SITRANS TF Ex d ¹⁾ • Total device SITRANS TF according to FM (XP, DIP, NI, S) ¹⁾	5 0 5 1 5 2 5 4 5 5 6 0 6 1 6 2 6 4 6 5		
Enclosure Die-cast aluminium Stainless steel precision casting	A E		
Connections/cable inlet Screwed glands M20x1.5 Screwed glands 1/2-14 NPT	B C		
Digital indicator Without With	0 1		
Mounting bracket and securing parts Without Made of steel Made of stainless steel	0 1 2		

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Selection and Ordering data	Order code
Customer-specific programming Add "-Z" to Article No. and specify Order code(s)	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	Y01²⁾
Measuring point no. (TAG), max. 8 characters	Y17³⁾
Meas. point descriptor, max. 16 characters	Y23⁴⁾
Meas. point message, max. 32 characters	Y24⁴⁾
Only inscription on measuring point label: specify in plain text: Measuring range	Y22⁴⁾
Pt100 (IEC) 2-wire, $R_L = 0 \Omega$	U02⁵⁾
Pt100 (IEC) 3-wire	U03⁵⁾
Pt100 (IEC) 4-wire	U04⁵⁾
Thermocouple type B	U20⁵⁾⁶⁾
Thermocouple type C (W5)	U21⁵⁾⁶⁾
Thermocouple type D (W3)	U22⁵⁾⁶⁾
Thermocouple type E	U23⁵⁾⁶⁾
Thermocouple type J	U24⁵⁾⁶⁾
Thermocouple type K	U25⁵⁾⁶⁾
Thermocouple type L	U26⁵⁾⁶⁾
Thermocouple type N	U27⁵⁾⁶⁾
Thermocouple type R	U28⁵⁾⁶⁾
Thermocouple type S	U29⁵⁾⁶⁾
Thermocouple type T	U30⁵⁾⁶⁾
Thermocouple type U	U31⁵⁾⁶⁾
With TC: CJC external (Pt100, 3-wire)	U41
With TC: CJC external with fixed value, specify in plain text	Y50
Special differing customer-specific programming, specify in plain text	Y09⁷⁾
Fail-safe value 3.6 mA (instead of 22.8 mA)	U36³⁾

Supply units see Chapter "Supplementary Components".

¹⁾ Without cable gland.

²⁾ For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.

³⁾ For this selection, Y01 or Y09 must also be selected.

⁴⁾ If only Y22, Y23 or Y24 are ordered and the label only has to be on the tag plate, Y01 does not have to be specified.

⁵⁾ For this selection, Y01 must also be selected.

⁶⁾ Internal cold junction compensation is selected as the default for TC.

⁷⁾ For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Selection and Ordering data	Article No.
Accessories	
Modem for SITRANS TH100, TH200, TR200 and TF with TH200 incl. parameterization software T with USB interface	7NG3092-8KU
MiniDVD for temperature measuring instruments with documentation in German, English, French, Spanish, Italian and Portuguese, and parameterization software SIPROM T (included in delivery with SITRANS TF)	A5E00364512
HART modem With USB interface	7MF4997-1DB
SIMATIC PDM parameterization software also for SITRANS TH300	see chapter 8
Mounting bracket and securing parts Made of steel for 7NG313.-..B.. Made of steel for 7NG313.-..C.. Made of stainless steel for 7NG313.-..B.. Made of stainless steel for 7NG313.-..C..	7MF4997-1AC 7MF4997-1AB 7MF4997-1AJ 7MF4997-1AH
Digital indicator¹⁾	7MF4997-1BS
Connection board	A5E02226423

► Available ex stock.

Supply units see Chapter "Supplementary Components".

¹⁾ It is not possible to upgrade devices with Ex protection

Ordering example 1:

7NG3135-0AB11-Z Y01+Y23+U03

Y01: -10 ... +100 °C

Y23: TICA1234HEAT

Ordering example 2:

7NG3136-0AC11-Z Y01+Y23+Y24+U25

Y01: -10 ... +100 °C

Y23: TICA 1234 ABC

Y24: HEATING BOILER 56789

Factory setting (transmitter):

- Pt100 (IEC 751) with three-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA


Selection and Ordering data		Article No.	Selection and Ordering data		Order code
SITRANS TF field indicator for 4 ... 20 mA signals, with documentation on MiniDVD		7NG3130 -	Customer-specific programming Add "-Z" to Article No. and specify Order code(s)		
➤ Click on the Article No. for the online configuration in the PIA Life Cycle Portal.			Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	Y01²⁾ Y22³⁾ Y23³⁾ Y24³⁾ Y09⁴⁾	
Without Ex-protection		0	Only inscription on TAG plate: specify in plain text: Measuring range		
With Ex ia		1	Only inscription on TAG plate: Measuring point descriptor, max. 16 characters		
With Ex nAL for zone 2		2	Only inscription on TAG plate: Measuring point message, max. 27 characters		
Total device SITRANS TF Ex d ¹⁾		4	Special differing customer-specific programming, specify in plain text		
Total device SITRANS TF according to FM (XP, DIP, NI, S) ¹⁾		5	Supply units see Chapter "Supplementary Components".		
Enclosure Die-cast aluminium Stainless steel precision casting		A E			
Connections/cable inlet Screwed glands M20x1.5 Screwed glands ½-14 NPT		B C			
Digital indicator With		1			
Mounting bracket and securing parts Without Made of steel Made of stainless steel		0 1 2			
Further designs Please add "-Z" to Article No. and specify Order code(s) and plain text.		Order code			
Test protocol (5 measuring points)		C11			
Explosion protection					
• Explosion protection Ex ia to INMETRO (Brazil) (only with 7NG313.-1....)		E25			
• Explosion protection Ex d to INMETRO (Brazil) (only with 7NG313.-1....)		E26			
• Explosion protection Ex nA to INMETRO (Brazil) (only with 7NG313.-2....)		E27			
• Explosion protection Ex i to NEPSI (China) (only with 7NG313.-1....)		E55			
• Explosion protection Ex d to NEPSI (China) (only with 7NG313.-4....)		E56			
• Explosion protection Ex nA to NEPSI (China) (only with 7NG313.-2....)		E57			
• Explosion protection Ex d to KOSHA (Korea) (only with 7NG313.-4....)		E70			
• Explosion protection Ex i according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-1....)		E81			
• Explosion protection Ex d according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-4....)		E82			
• Explosion protection Ex nA according to EAC (Russia/Belarus/Kazakhstan) (only for 7NG313.-2....)		E83			
Marine approvals					
• Det Norske Veritas Germanischer Lloyd (DNV GL)		D01			
• Bureau Veritas (BV)		D02			
• Lloyd's Register of Shipping (LR)		D04			
• American Bureau of Shipping (ABS)		D05			
Two coats of lacquer on casing and cover (PU on epoxy)		G10			
Transient protection		J01			
Cable gland CAPRI 1/2 NPT ADE 4F, nickel-plated brass (CAPRI 848694 and 810634) included		D57			
Cable gland 1/2 NPT ADE 1F, cable diam. 6 ... 12 (CAPRI 818694 and 810534) included		D58			
Cable gland 1/2 NPT ADE 4F, stainless steel (CAPRI 848699 and 810634) included		D59			
Cable gland 1/2 NPT ADE 1F, cable diam. 4 ... 8.5 (CAPRI 818674 and 810534) included		D60			
			Selection and Ordering data	Article No.	
			Accessories		
			MiniDVD for temperature measuring instruments ➤	A5E00364512	
			with documentation in German, English, French, Spanish, Italian and Portuguese, and parameterization software SIPROM T (included in delivery with SITRANS TF)		
			Mounting bracket and securing parts		
			Made of steel for 7NG313.-..B..	7MF4997-1AC	
			Made of steel for 7NG313.-..C..	7MF4997-1AB	
			Made of stainless steel for 7NG313.-..B.. ➤	7MF4997-1AJ	
			Made of stainless steel for 7NG313.-..C..	7MF4997-1AH	
			Digital indicator¹⁾	7MF4997-1BS	
			Connection board	A5E02226423	
			➤ Available ex stock.		
			¹⁾ It is not possible to upgrade devices with Ex protection		
			<u>Ordering example 1:</u>		
			7NG3130-0AB10-Z Y01+Y23		
			Y01: -5...100 °C		
			Y23: TICA1234HEAT		
			<u>Ordering example 2:</u>		
			7NG3130-0AC10-Z Y01+Y23+Y24		
			Y01: 0 ... 20 BAR		
			Y23: PICA 1234 ABC		
			Y29: HEATING BOILER 67890		
			<u>Factory setting (field indicator):</u>		
			4 ... 20 mA		

Temperature Measurement

Transmitter for field mounting/field indicator

SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

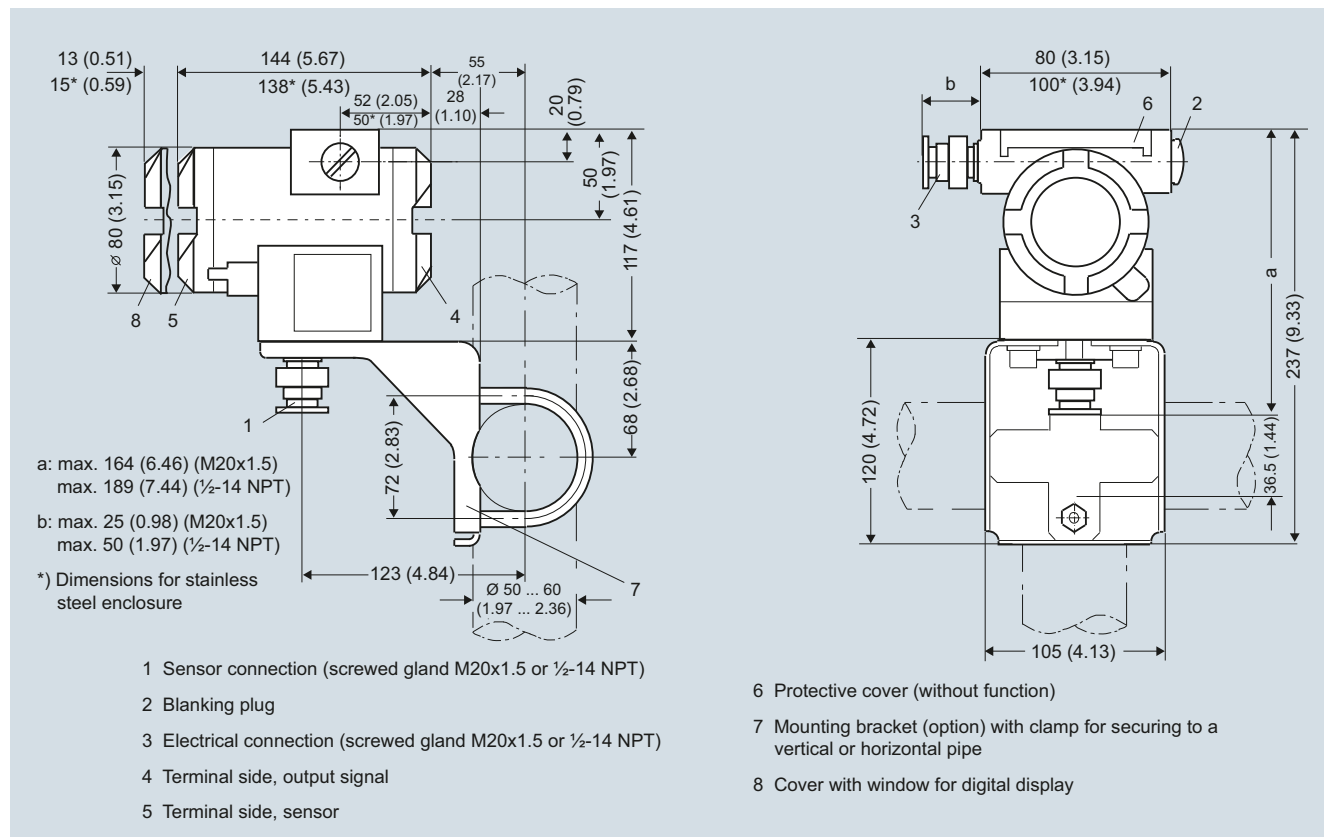Dimensional drawings



SITRANS TF, dimensions in mm (inches)



Temperature Measurement

Transmitter for field mounting/field indicator


SITRANS TF - Transmitter, two-wire system and SITRANS TF - Field indicator for 4 to 20 mA

Schematics


Resistance thermometer

Two-wire system ¹⁾



Three-wire system




Four-wire system

Generation of average value / difference ¹⁾¹⁾ Programmable line resistance for the purpose of correction.


Resistance

Two-wire system ¹⁾





Three-wire system




Four-wire system

Generation of average value / difference ¹⁾


Thermocouple

Cold junction compensation
Internal/fixed valueCold junction compensation with
external Pt100 in two-wire system ¹⁾Cold junction compensation with
external Pt100 in three-wire systemGeneration of average value / difference
with internal cold junction compensation

Voltage measurement



Current measurement



SITRANS TF, sensor connection assignment